

HEATED AREA - 1400 SQ. FT.


FLOOR PLAN SCALE 1/4" = 1'-0"

CONSTRUCTION CHECK LIST


1. CHECK LOCAL BUILDING CODE AND LOAN COMPANY CRITERIA. PURCHASED TRUSSES SHOULD MEET LOCAL SNOW LOAD CRITERIA.
2. ADEQUATELY NAIL AND ANCHOR JOINTS.
3. SEALATE CORNERS WITH 1/2" PLYWOOD OR HIGH DENSITY FIBERBOARD OR USE DIAGONAL BRACING.
4. USE EXTERIOR CLUED PLYWOOD WHEREVER IT MAY BE WETTED DURING OR AFTER CONSTRUCTION.
5. PRESSURE TREAT ALL WOOD WITH GROUND CONTACT AND PROVIDE OTHER NEEDED TERMITE CONTROL.
6. R VALUES DEPEND ON LOCAL CLIMATE AND FUEL COSTS.
7. PROVIDE 1 SQ FT OF ATTIC VENT OPENINGS FOR EACH 150 SQ FT OF CEILING.
8. WEATHERIZE ALL OPENINGS AND JOINTS.
9. DOUBLE JOISTS UNDER TUBS AND OTHER HEAVY LOADS.

MARK	SIZE	W.H.D.V. SCHEDULE	NO. REQ'D
A	3'-4" x 4'-0"	DOUBLE HUNG INSULATED GLASS	12
B	2'-11" x 1'-6" / 7'-8"	BRISNER INSULATED GLASS	7


MARK	SIZE	TYPE	NO. REQ'D
1	3'-0" x 6'-0"	EXTERIOR DOOR	3
2	3'-0" x 6'-0"	ENTRY DOOR	4
3	1'-3" x 6'-0"	GLASS PANELED DOOR	2
4	2'-3" x 6'-8"	INTERIOR FIRE PANEL	4
5	4'-3" x 6'-8"	FOLDING DOOR	8
6	2'-3" x 6'-8"	INTERIOR FIRE PANEL	3
7	3'-0" x 6'-8"	SALING DOOR	2

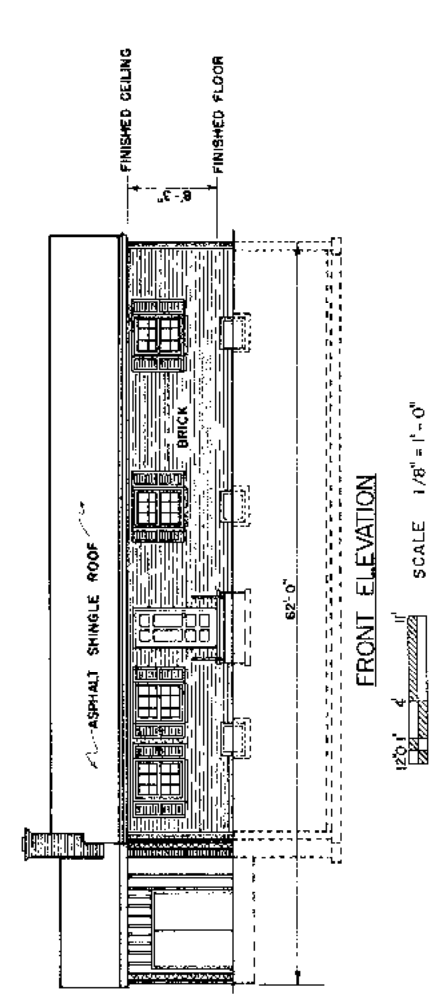


FRONT ELEVATION

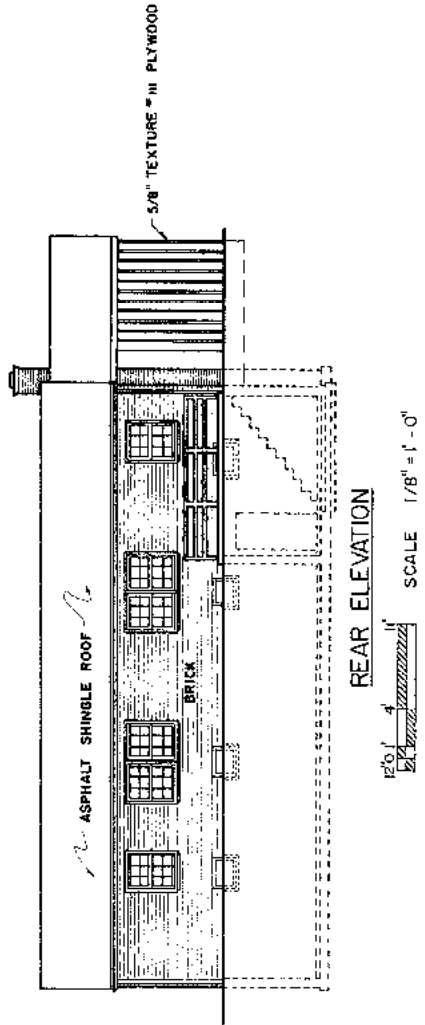


REAR ELEVATION

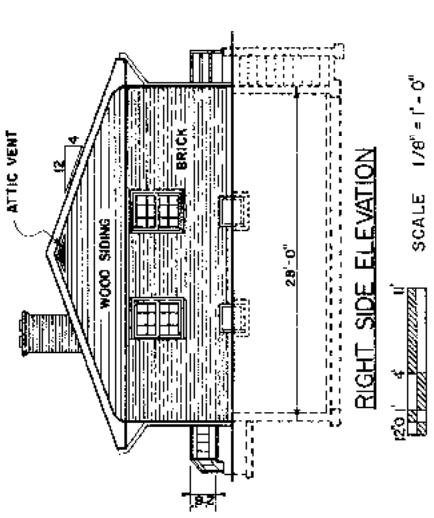

RIGHT SIDE ELEVATION

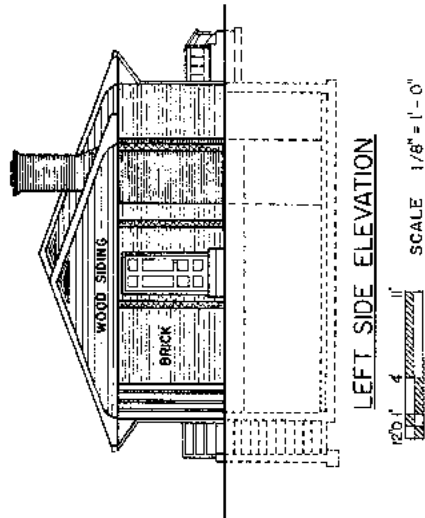


LEFT SIDE ELEVATION

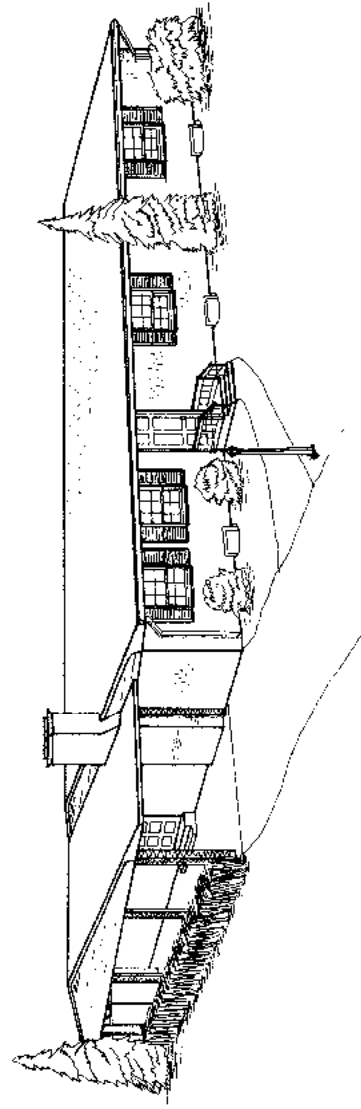

PERSPECTIVE VIEW
(NOT TO SCALE)

3 BEDROOM HOUSE		
FLA-VA '65	7180	SHEET 2 OF 3
REVISED 1985		

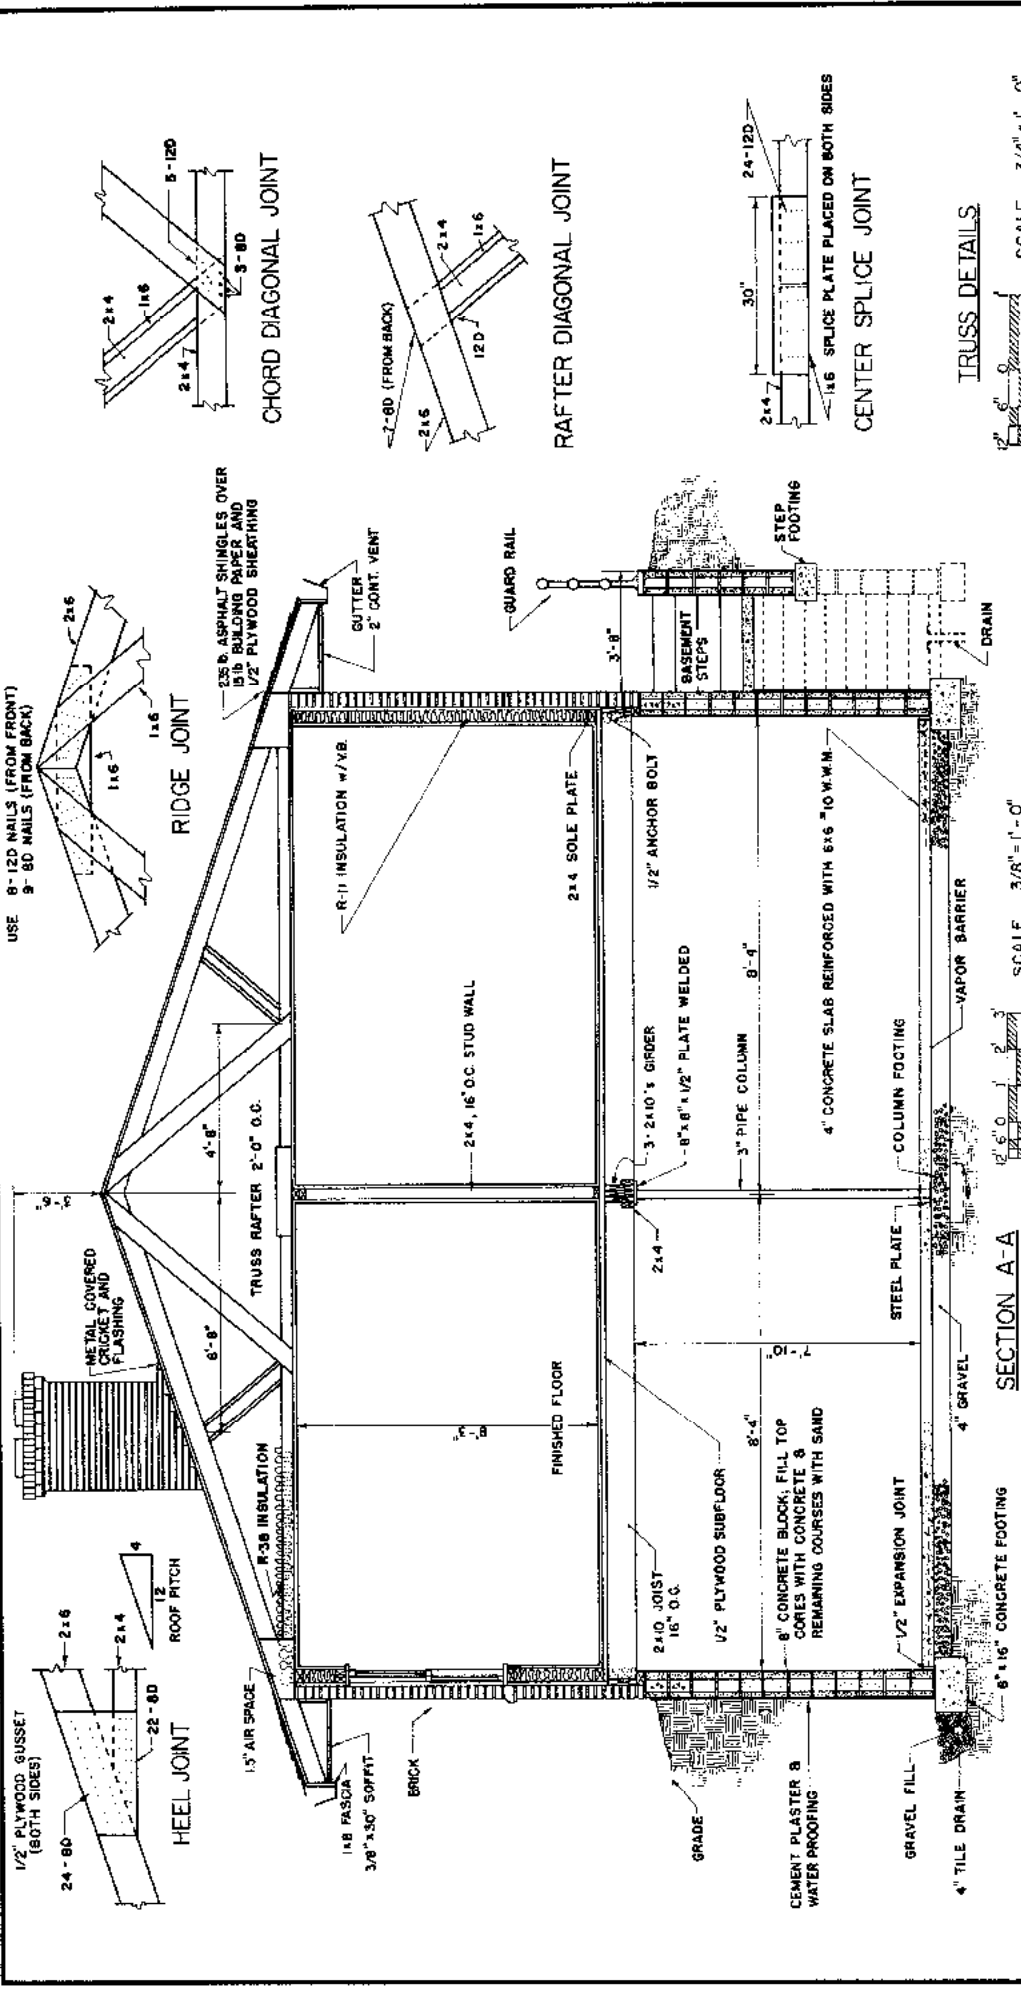


TRUSS DETAILS

SCALE 3/4" = 1'-0"

NOTE:
COMMERCIAL MANUFACTURED TRUSSES
MAY BE SUBSTITUTED.


SECTION A-A

SCALE 3/8" = 1'-0"

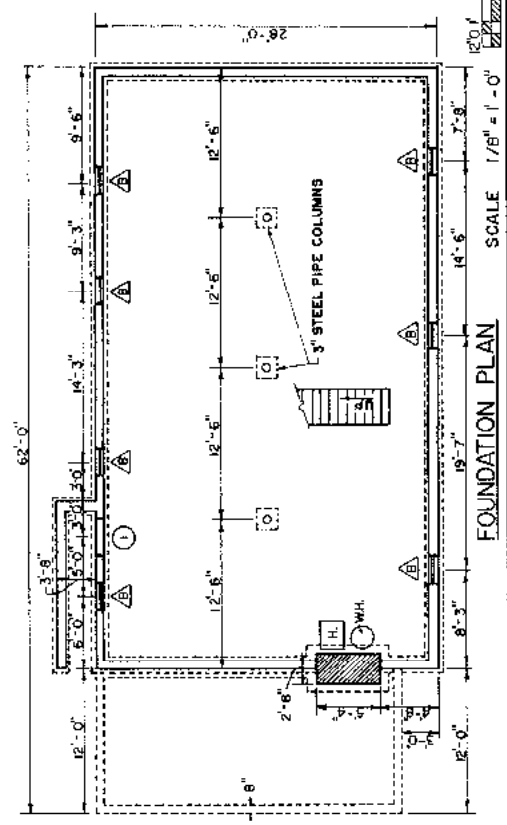

FOUNDATION PLAN

SCALE 1/8" = 1'-0"

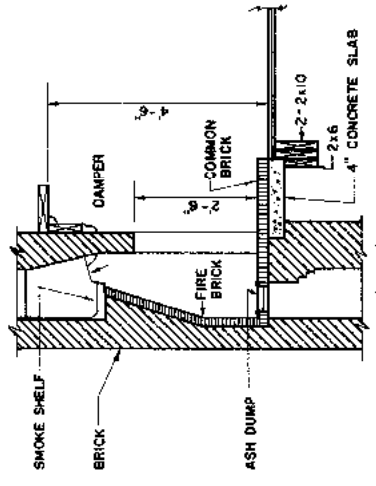

FIREPLACE DETAIL

SCALE 1/2" = 1'-0"